

FD9

COSHH essentials for
foundries

Shot-blasting castings

Control approach: Engineering and RPE

The Control of Substances Hazardous to Health Regulations 2002 (COSHH) require employers to ensure that exposure is prevented or, where this is not reasonably practicable, adequately controlled. This guidance gives practical advice on how this can be achieved by applying the principles of good practice for the control of exposure to substances hazardous to health, as required by COSHH.

It is aimed at people whose responsibilities include the management of substances hazardous to health at work, eg occupational health specialists, anyone undertaking COSHH assessments and supervisors. It is also useful for trade union and employee safety representatives). It will help you carry out COSHH assessments, review existing assessments, deliver training and supervise activities involving substances hazardous to health.

This guidance is issued by the Health and Safety Executive. Following the guidance is not compulsory, unless specifically stated, and you are free to take other action. But if you do follow the guidance you will normally be doing enough to comply with the law. Health and safety inspectors seek to secure compliance with the law and may refer to this guidance.

See Essential information near the end of the sheet.

What this sheet covers

This sheet describes good practice for the control of dust from shot-blasting small and medium sized castings in an extracted cabinet or enclosure. For large castings, where extraction is not reasonably practicable, refer to COSHH Essentials sheet WL20. See Essential information.

It covers the key points you need to follow to help reduce exposure to an adequate level.

This is achieved by following good control practice (ie follow all points described in this sheet or use equally effective measures), and by reducing exposure to below the relevant workplace exposure limits (WELs).

Hazards

Health hazards in foundries include dusts (foundry sands, fettlings and kiln linings contain silica), metal fumes, products of combustion and thermal decomposition, and substances associated with binder systems.

Crystalline silica dust, which is fine enough to reach deep inside the lung, is known as respirable crystalline silica (RCS). Exposure to RCS can cause silicosis, where irreversible lung damage can be present before any symptoms develop. Silicosis may continue to worsen even after exposure to RCS stops. RCS can also cause other serious diseases such as chronic obstructive pulmonary disease (COPD) and lung cancer. The workplace exposure limit for RCS is detailed in HSE publication EH40/2005 Workplace Exposure Limits (see Essential information).

RCS dust is also abrasive and drying when in contact with skin and can lead to contact dermatitis.

Metals found in dust can include nickel, chromium, manganese, cobalt and lead. Some metals such as nickel and cobalt can cause dermatitis and skin allergies.

Access to work area

- ✓ Allow access to authorised and appropriately trained people only.
- ✓ Segregate this task to reduce spreading of airborne contamination to other workers.

Equipment and procedures

- ✓ Use non-silica abrasives such as steel shot.
- ✓ Enclose and extract the process.
- ✓ Automate the process where reasonably practicable.

- ✓ For semi-automated processes, fit flexible curtain strips at each entry/exit point where the castings enter the shot blasting system, which must be extracted.
- ✓ For shot blasting of small castings use a fully enclosed and extracted shot-blasting cabinet (see Figure 1).
- ✓ Where castings are larger in size, use a fully enclosed, extracted booth with the operator working inside, protected with a blasting helmet and airline breathing apparatus (see Figure 2). Keep the enclosure under negative pressure.
- ✓ Discharge extracted air to a safe place outside the building away from doors, windows and air inlets.
- ✓ Do not use a recirculating LEV system unless the air is thoroughly cleaned before its return to the workplace.

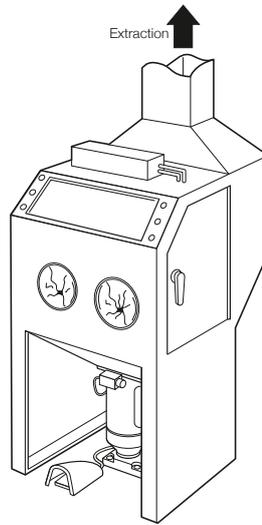


Figure 1 Shot-blasting cabinet for smaller castings

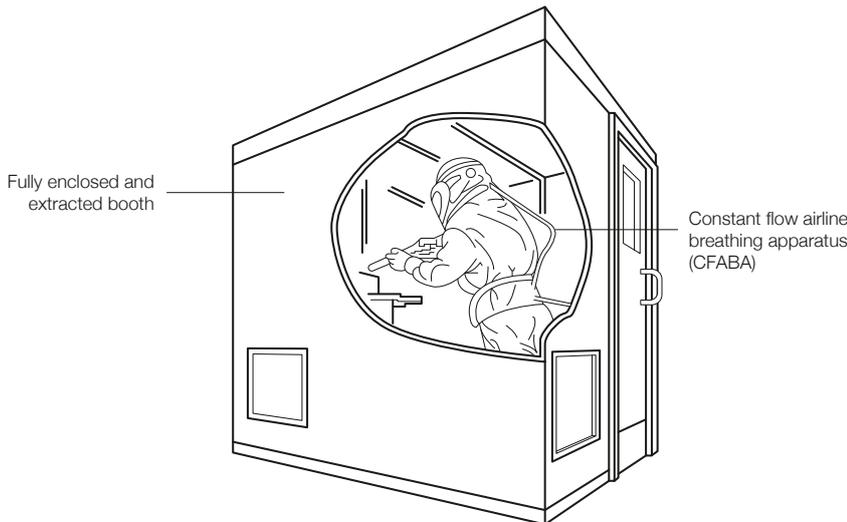


Figure 2 Shot-blasting in an enclosed and extracted booth

- ✓ Have a supply of clean air coming into the workroom to replace extracted air.
- ✓ Where control dampers and valves are provided to adjust airflow in branching LEV systems, ensure there are measures in place to prevent unauthorised adjustment.

Respiratory protective equipment (RPE)

- ✓ RPE is normally not needed when the shot blasting process is enclosed, and the worker is separated from it.
- ✓ RPE is needed when the worker is working within the shot blasting booth.
- ✓ Provide constant flow airline breathing apparatus (CFABA). Ensure that the CFABA provided has an assigned protection factor (APF) of at least 40 (see sheet R5 in Essential information).
- ✓ Air supplied to CFABA should meet minimum quality requirements, in line with the latest British Standard.

-
- ✓ Check the quality of the air supply to the airline breathing apparatus at least every three months and more often when the quality of air cannot be assured to these levels.
 - ✓ Visually check the compressed airlines for signs of damage before each use.
 - ✓ Maintain the airline breathing apparatus at least once every month. Replace valves, face seals and worn or damaged parts on respirators. The valves need changing frequently if substances such as paint spray land on them.
 - ✓ Keep a small stock of replaceable parts.
 - ✓ Keep airline oil and water traps empty and filters clean.
 - ✓ Keep breathing apparatus clean and store it in a clean place.
 - ✓ RPE is needed for cleaning and maintenance.
 - ✓ Provide RPE with an assigned protection factor (APF) of at least 20 (eg powered TH2). See sheet R3 in Essential information.
 - ✓ Face fit testing is required for RPE with a tight fitting face seal. See INDG 479 in Essential information.

Personal protective equipment (PPE)


- ✓ Ask your supplier to advise on suitable PPE.
- ✓ Consult workers to ensure PPE will be suitable for them.
- ✓ Make suitable arrangements for maintenance, storage and replacement of PPE. Provide separate storage for clean and contaminated PPE.
- ✓ Provide overalls that do not retain dust – synthetic rather than cotton.
- ✓ Provide suitable chemical resistant gloves.
- ✓ Workers should change and discard damaged gloves immediately.
- ✓ Keep any PPE clean and replace at recommended intervals.
- ✓ Do not allow workers to wear their own outer clothing in contaminated areas.
- ✓ Use a contract laundry or a suitable equivalent to wash work clothing. Warn them of any hazardous substances on the clothing.

Personal decontamination and skin care

- ✓ Prohibit eating, drinking and smoking in contaminated areas.
- ✓ Provide warm water, mild skin cleansers, and soft paper or fabric towels for drying. Avoid abrasive cleansers.
- ✓ Provide pre-work skin creams, which will make it easier to wash dirt from the skin.
- ✓ Provide after-work creams to replenish skin oils.
- ✓ Barrier creams are not 'liquid gloves' and do not provide a full barrier.

Maintenance, examination and testing

- ✓ Extraction and plant wear out quickly. Plan regular maintenance.
- ✓ Keep all equipment used for the task in effective working order. Maintain it as advised by the supplier or installer.
- ✓ Check for signs of damage to control equipment before starting work. In particular check seals and the integrity of enclosures.
- ✓ Have equipment thoroughly examined and tested against its performance standard, at suitable intervals.

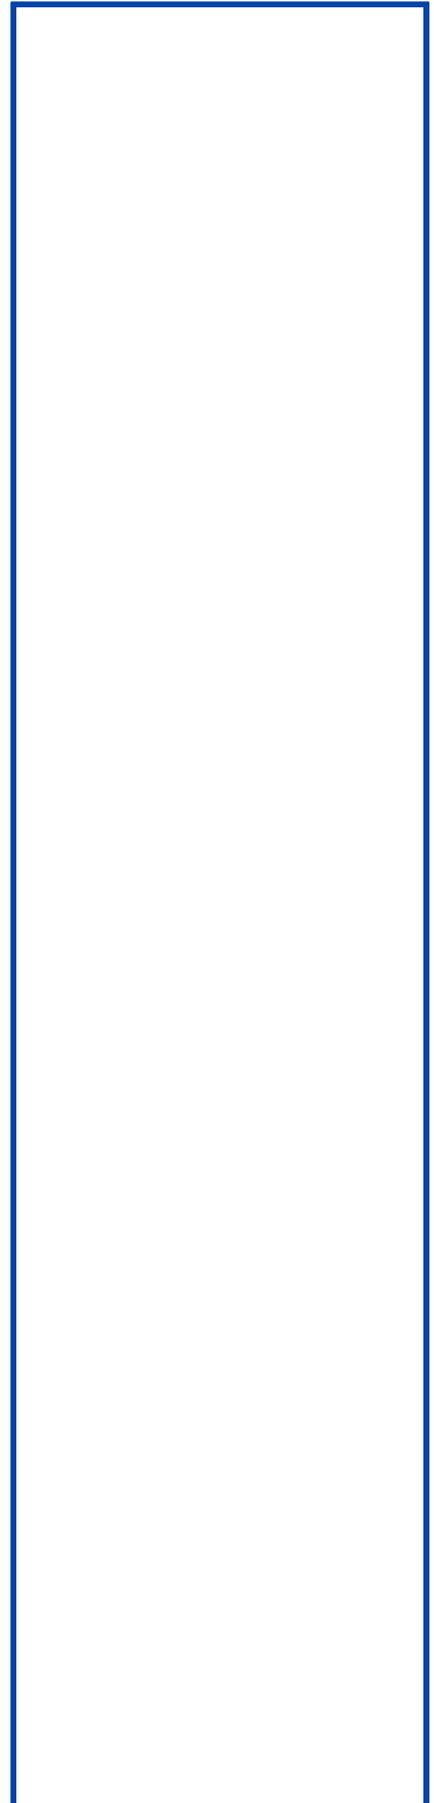

-
- ✓ For LEV a user manual or log book is helpful in setting out the frequency of checking, maintenance or parts replacement.
 - ✓ For LEV with no user manual or log book, you may need the help of a competent person. They can determine the performance needed for adequate control.
 - ✓ LEV systems require a statutory ‘thorough examination and test’ (TExT).
 - ✓ Get a competent person to perform the TExT at least every month.
 - ✓ Carry out all actions arising from the TExT.
 - ✓ Keep records of all examinations for at least 5 years.
 - ✓ Several measures are available to check effectiveness of controls ranging from simple qualitative (eg use of dust lamp) to complex quantitative techniques (eg air sampling and/or biological monitoring) usually for higher risk scenarios. See sheet G409 in Essential information.

Cleaning and housekeeping

- ✓ Clean work equipment and the work area daily. Clean other equipment and the workroom regularly – at least once a week.
- ✓ Vacuum dry dust.
- ✓ Use vacuum equipment that meets at least the dust Class M (medium hazard) classification.
- ✓ Avoid the use of brushes or compressed air for removing dust from clothing, surfaces and machinery.

Health surveillance

- ✓ Provide health surveillance for dermatitis where there is a reasonable likelihood that dermatitis may occur in your workplace. See sheet G403 in Essential information.
- ✓ Provide health surveillance when workers are regularly exposed to RCS dust and there is a reasonable likelihood that COPD and/or silicosis may develop. See sheet G404 in Essential information.
- ✓ Workers undertaking the task described in this sheet will normally need health surveillance.
- ✓ You will need to take advice from a competent occupational health professional (a doctor or nurse) when setting up a health surveillance programme.
- ✓ If workers are exposed to lead, you must comply with the Control of Lead at Work Regulations.

Training and supervision

- ✓ Tell workers about the hazards associated with their work and how to prevent and recognise early signs of lung damage and dermatitis.
- ✓ Provide workers with training on:
 - working safely with hazardous substances;
 - when and how to use controls;
 - how to check they are working;
 - what to do if something goes wrong.
- ✓ Provide supervision – ensure that safe work procedures are followed.
- ✓ Involve managers and supervisors in health and safety training.
- ✓ Training records are helpful to demonstrate what information, instruction and training has been provided.

Essential Information

- G403 – Health surveillance for occupational dermatitis.
<https://www.hse.gov.uk/pubns/guidance/g403.pdf>
- G404 – Health surveillance for those exposed to respirable crystalline silica (RCS). <https://www.hse.gov.uk/pubns/guidance/g404.pdf>
- G409 – Exposure measurement: Air sampling.
<https://www.hse.gov.uk/pubns/guidance/g409.pdf>
- R3 – UK Standard Assigned Protection Factor 20 (APF 20)
<https://www.hse.gov.uk/pubns/guidance/rpe3.pdf>
- R5 – UK Standard Assigned Protection Factor 40 (APF 40)
<https://www.hse.gov.uk/pubns/guidance/rpe5.pdf>
- Guidance on respiratory protective equipment (RPE) fit testing Leaflet INDG479(rev1) HSE 2019 www.hse.gov.uk/pubns/indg479.htm
- EH40/2005 Workplace exposure limits HSE 2020
www.hse.gov.uk/pubns/books/eh40.htm
- WL20 - Surface preparation: pressure blasting (large items).
<https://www.hse.gov.uk/pubns/guidance/wl20.pdf>
- L132 - Control of Lead at Work Regulations 2002 Approved Code of Practice and guidance (Third edition). HSE 2002.
<https://www.hse.gov.uk/pubns/priced/l132.pdf>

Further information

You can find the full COSHH essentials series at Foundry - COSHH e-tool (hse.gov.uk)

Control of exposure to silica dust - A guide for employees indg463.pdf (hse.gov.uk)

Controlling airborne contaminants at work: A guide to local exhaust ventilation (LEV), HSG258. www.hse.gov.uk/pubns/books/hsg258.htm

Respiratory protective equipment at work - A practical guide, HSG53. www.hse.gov.uk/pubns/books/hsg53.htm

Health surveillance for those exposed to respirable crystalline silica (RCS) - Guidance for occupational health professionals. Published 2015 <http://www.hse.gov.uk/pubns/priced/healthsurveillance.pdf>

The dust lamp: A simple tool for observing the presence of airborne particles MDHS82.
<https://www.hse.gov.uk/pubns/mdhs/pdfs/mdhs82-2.pdf>

L5 - The Control of Substances Hazardous to Health Regulations 2002. Approved Code of Practice and guidance (Sixth edition)
<https://www.hse.gov.uk/pubns/books/l5.htm>

BOHS Directory of Occupational Hygiene Consultants:
www.bohs.org/find-expertise/

Institute of Local Exhaust Ventilation Engineers Accredited members
Institute of Local Exhaust Ventilation Engineers (ILEVE) | CIBSE

For information about health and safety visit <https://books.hse.gov.uk> or <http://www.hse.gov.uk>

You can view HSE guidance online and order priced publications from the website. HSE priced publications are also available from bookshops.

To report inconsistencies or inaccuracies in this guidance email:
commissioning@williamslea.com

Employee checklist

- Do you understand the health hazards associated with your work?
- Are you sure about safe work procedures?
- Are you sure how to use all controls?
- If you find any problems, tell your supervisor, don't just carry on working.
- Is the LEV system switched on and working properly? Check the gauge.
- Co-operate with health surveillance.
- Use, maintain and store your PPE in accordance with instructions.
- Check that any RPE works properly every time you use it. Look for signs of leaks, wear and damage.
- Wash hands before eating, drinking, smoking, using the lavatory and after work.
- Follow any skin care programme provided. Never use solvents to clean your skin.